

# A-520E

## Macroporous Strong Base Anion Exchange Resin

(For the selective removal of nitrate)

### Technical Data

#### PRODUCT DESCRIPTION

**Purolite A-520E** is a macroporous strong base anion resin which is specially designed for the removal of nitrates from water for potable processes. The macroporous matrix and special ion exchange group functionality imparts ideal nitrate selectivity to **Purolite A-520E** making this resin particularly suitable for nitrate removal even when moderate to high concentrations of sulphate are present. Hence this resin gives superior performance in nitrate removal applications when compared with standard exchange resins.

A requirement of the nitrate removal process is to produce potable water meeting the quality standard defined by the European Economic Community in the Directive No. 80/778 of July 1980. This directive limits the nitrates to a maximum admissible concentration (M.A.C.) of 50 mg NO<sub>3</sub>/l. The U.S.A. drinking water regulations limit nitrates to 45 mg NO<sub>3</sub>/l.

Typical Physical & Chemical Characteristics	
Polymer Matrix Structure	Macroporous Styrene-Divinylbenzene
Physical Form and Appearance	Opaque Cream Spherical Beads
Whole Bead Count	95% min.
Functional Groups	Quaternary Ammonium
Ionic Form, as shipped	Cl <sup>-</sup>
Shipping Weight (approx.)	680 g/l (42.5 lb/ft <sup>3</sup> )
Screen Size Range: - U.S. Standard Screen	16 - 50 mesh, wet
Particle Size Range	+1200 mm <5%, -300 mm <1%
Moisture Retention, Cl <sup>-</sup> form	50 - 56%
Reversible Swelling Cl <sup>-</sup> → SO <sub>4</sub> /NO <sub>3</sub>	negligible
Total Exchange Capacity, Cl <sup>-</sup> form,	
wet, volumetric	0.9 meq/ml min.
dry, weight	2.8 meq/g min.
Operating Temperature, Cl <sup>-</sup> Form	100°C (212°F) max.
pH Range, Stability	0 - 14
pH Range, operating	4.5 - 8.5

Standard Operating Conditions Nitrate Removal				
Operation	Rate	Solution	Minutes	Amount
Service	8 - 32 BV/h 1 - 4 gpm/ft <sup>3</sup>	Influent water to be treated	per design	per design
Backwash	Refer to Fig. 2	Influent water 10 - 20°C (50 - 68°F)	5 - 20	1.5 - 4 BV 10 - 25 gal/ft <sup>3</sup>
Regeneration	2 - 5 BV/h 0.25 - 0.6 gpm/ft <sup>3</sup>	3 - 10% NaCl	20 - 60	90 - 250 g/l 7.8 - 15.6 lb/ft <sup>3</sup>
Rinse, (slow)	2 - 5 BV/h 0.25 - 0.6 gpm/ft <sup>3</sup>	Influent water	20 - 60	2 - 5 BV 15 - 40 gal/ft <sup>3</sup>
Rinse, (fast)	8 - 32 BV/h 1 - 4 gpm/ft <sup>3</sup>	Influent water	-	-
Backwash Expansion 50% to 75%				
Design Rising Space 100%				
"Gallons" refer to U.S. Gallon = 3.785 litres				

## REGENERATION

Sodium chloride is generally preferred for regeneration for reasons of cost and efficiency. When available sea water can be used quite effectively. The use of softened water for make up of regenerant and rinse is often recommended to avoid the precipitation of calcium carbon-

ate in and around the **Purolite A-520E** (or any other resin used in this application). Although the precipitation is not particularly detrimental in the short term, the long term effects may include increased resin attrition and leakage of nitrates.

## PRECONDITIONING PROCEDURE

**Purolite A-520E** is processed to insure that it meets the requirements for use in the treatment of potable water.

On installation it is recommended that the resin be regenerated with two bed volumes of 6% NaCl followed by a rinse of four bed volumes of potable water, prior to use.


## HYDRAULIC CHARACTERISTICS

The pressure drop or headloss across a properly classified bed of ion exchange resin depends on the particle size distribution, bed depth, and void volume of the exchange material as well as on the viscosity (and hence on the temperature) of the influent solution. Factors affecting any of these parameters, for example the presence of particulate matter filtered out by the bed, abnormal compressibility of


the resin, or the incomplete classification of the bed will have an adverse effect and result in an increased headloss.

Depending on the quality of the influent water, the application and the design of the plant, service flow rates may vary from 10 - 40 bed volumes/hour (1 - 5 gpm/ft<sup>3</sup>). Typical pressure drop data is given in Fig. 1.

**Fig. 1 PRESSURE DROP CHARACTERISTICS**

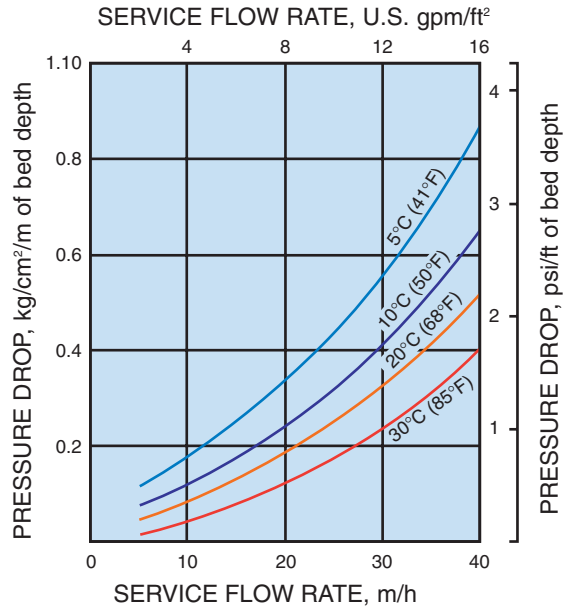

**Fig. 2 BACKWASH EXPANSION**

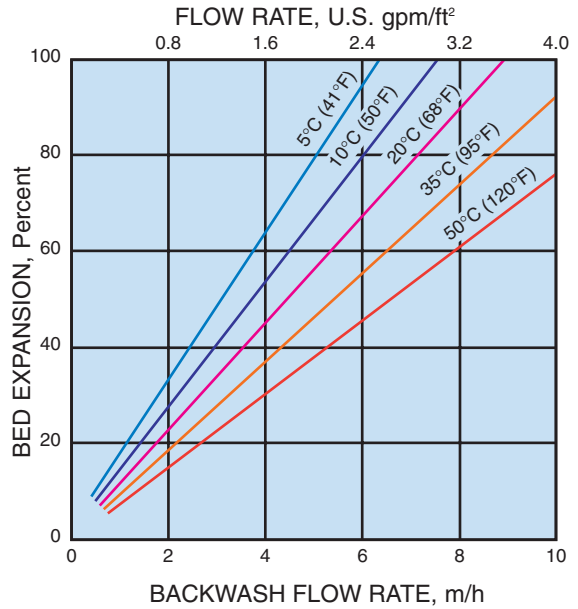

During upflow backwash, the resin bed should be expanded in volume by between 50 and 70%. This operation will free it from any particulate matter, clear the bed of bubbles and voids, and reclassify the resin parti-

cles, ensuring minimum resistance to flow. Bed expansion increases with flow rate and decreases with temperature, as shown in Fig. 2. Care should be taken to avoid over expansion of the bed.


Conversion of Units	
1 m/h (cubic meters per square meter per hour)	= 0.341 gpm/ft <sup>2</sup> = 0.409 U.S. gpm/ft <sup>2</sup>
1 kg/cm <sup>2</sup> /m (kilograms per square cm per meter of bed)	= 4.33 psi/ft = 1.03 atmos/m = 10 ft H <sub>2</sub> O/ft

## OPERATING PERFORMANCE

The high selectivity of **Purolite A-520E** for nitrate over sulphate ensures that any necessary reduction in nitrate levels can be achieved even in the presence of high influent sulphate concentration. Hence it so offers the advantage over standard strong base resins that its exchange capacity for nitrates is less affected by a high influent

concentration of sulphate. For this reason, although **Purolite A-520E** has a lower total exchange capacity than standard strong base anion resin, its use can produce advantageously higher throughputs for the following reasons.

Both standard gel type or macroporous strong base resins are quite capable of effective nitrate removal where sulphate to total anion ratios are low. However, on account of the high selectivity for sulphate in dilute solutions which follows the order,




selective displacement of nitrate by sulphate results in the effective nitrate removal capacity being reduced by

sulphate loading. Apart from the obvious disadvantage of the reduction of treated water obtained on cycling, the exchange of both nitrate and sulphate by chloride will result in a less palatable and sometimes less acceptable water than the influent supply, in that the treated water may be more corrosive and the limits for chloride concentration may be exceeded.

## PUROLITE A-520E, CO-FLOW REGENERATION

**Fig. 3 OPERATING CAPACITY**

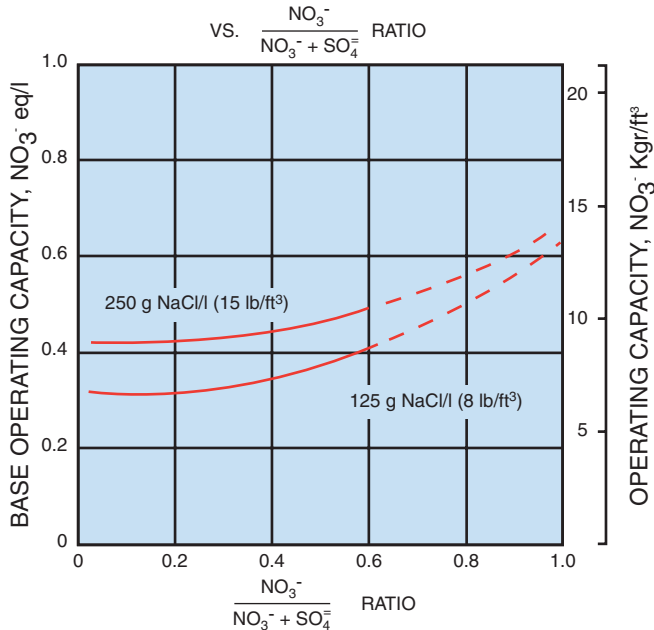

**Fig. 4 NITRATE LEAKAGE**

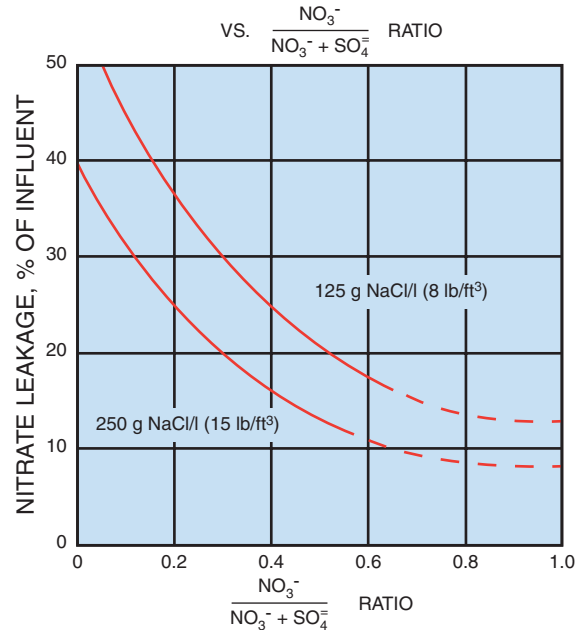


Fig. 3 and Fig. 4 give the operating capacity and nitrate leakage respectively which may be obtained using co-current regeneration at the given regeneration levels. Values obtained from Fig. 3 are expressed in terms of

nitrate throughput, corrected for nitrate leakage, and hence may not be used directly to determine the throughput of water. All ion concentration values are either on a ppm or a meq/l basis for ratio determination.


Calculation for throughput of treated water	
cyclic output (liters) = $\frac{V \times OC}{L - l_n} \times 10^3$	where V = resin volume (liters) OC = operating capacity (eq/l) L = nitrate load (meq/l) l <sub>n</sub> = nitrate leakage (meq/l)
or cyclic output (U.S. gal) = $\frac{V_f \times OC_k \times 10^3}{0.058 (L_p - l_{np})}$	where V <sub>f</sub> = resin volume (ft <sup>3</sup> ) OC <sub>k</sub> = operating capacity (kgr/ft <sup>3</sup> ) L <sub>p</sub> = nitrate load (ppm as CaCO <sub>3</sub> ) n <sub>p</sub> = nitrate leakage (ppm as CaCO <sub>3</sub> )

Similarly Fig. 5 and Fig. 6 give the values for counter-current regeneration. It should be noted that in this case the nitrate leakage is lower for a given regeneration level. Hence the possibility to blend treated with untreated water on a 50% basis is a useful option which can make counter-current regeneration attractive. On the other hand the choice of co-current regeneration can result in the production of higher volumes of treated water of satisfactory quality for direct use. The higher


leakage ( $I_n$ ,  $I_{np}$ , in the equations above) so reduces the load on the ion exchange bed that for a given operating capacity greater throughputs per cycle are obtained. This latter effect can influence the throughput more than differences in basic operating capacity. It therefore follows that both capacity and leakage for alternative modes of regeneration should be evaluated before recommending specific design conditions.

## PUROLITE A-520E, COUNTER-FLOW REGENERATION

**Fig. 5 OPERATING CAPACITY**

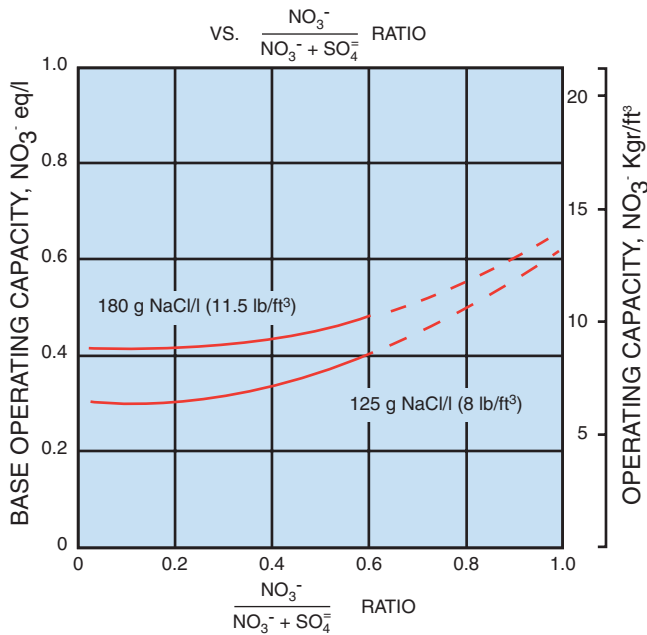

**Fig. 6 NITRATE LEAKAGE**

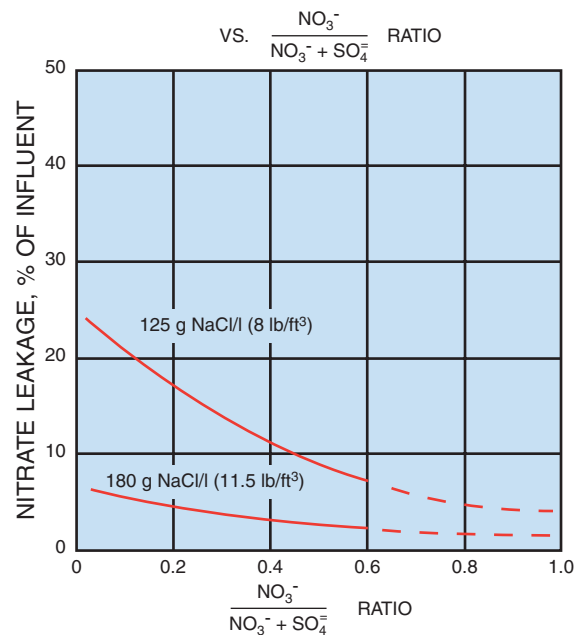

Presupposing that the objective of the nitrate removal treatment is to obtain potable water of a quality which meets the World Health Organization (WHO) limit, where the nitrate/(nitrate + sulphate) ratio is higher than 0.6, a nitrate selective resin is not necessary. A standard strong base resin can give higher throughputs as a result of its higher total capacity. It will be seen that up to the ratio of 0.6 the curves in Figs. 3 - 6 are continuous to show where **Purolite A-520E** is the recommended resin. The discontinuous curves are given so that comparisons

may be made with alternative resins. Where lower leakages than the WHO limit are required, for example in the processing of certain foods, **Purolite A-520E** will often give a superior performance to the standard resins even where nitrate/(nitrate + sulphate) ratios are higher than 0.6. One particular advantage here is that there is no slug of highly concentrated nitrate at breakthrough as is found with standard resins, hence the possibility to excessively contaminate the food product by overrunning the bed is avoided.

## EXAMPLE OF CALCULATION

How to use Figs. 3 through 6.

It is assumed that it is required to treat a well water of the following analysis to produce a nitrate concentration of less than 50 mg/l.

### WATER ANALYSIS

Anions	ppm	meq/l	ppm as CaCO <sub>3</sub>	Cations	ppm	meq/l
Nitrate	93	1.5(L)	76(L <sub>p</sub> )	Calcium	90	4.5
Sulphate	98	2.0	100	Magnesium	18	1.5
Chloride	71	2.0	100	Sodium	30	1.3
[HCO <sub>3</sub> *]	122	<u>2.0</u>	100]	Potassium	8	<u>0.2</u>
Total Anions		7.5		Total Cations		7.5
Equivalent Mineral Acidity (EMA)		<u>5.5</u>				

$$\frac{\text{Nitrate}}{\text{Nitrate} + \text{Sulphate}} = \frac{\text{NO}_3^-}{\text{NO}_3^- + \text{SO}_4^{2-}} = \frac{76}{76 + 100} = 0.43$$

\*Note: Unless concentration of bicarbonates is well above average it does not affect the performance to a significant extent.

A regeneration level of 125 g NaCl/l has first been chosen, using co-current regeneration.

To calculate the cyclic throughput from the equations given above;

From Fig. 3, Base Capacity at 0.43 for  $\frac{\text{NO}_3^-}{\text{NO}_3^- + \text{SO}_4^{2-}} = 0.36 \text{ eq/l}$

From Fig. 4, Leakage at  $\frac{0.43 \text{ NO}_3^-}{\text{NO}_3^- + \text{SO}_4^{2-}} = 23\%$

Hence for each litre of resin, throughput = (0.36/1.15) x 10<sup>3</sup> liters  
= 313 liters

And for each cubic foot of resin, = [7.9/(0.058 x 57.7)] x 10<sup>3</sup>  
= 2360 U.S. gal.

Depending upon the throughput requirement the resin volume is chosen so as to operate within the flow rate stipulations given in the standard operating conditions above. A design factor of 0.9 is also recommended as is customary. Hence throughput/liter of resin for design purposes will be 313 x 0.9 = 281.7 liters (2124 U.S. gal/ft<sup>3</sup>).

In this example the leakage is 17.3 ppm as CaCO<sub>3</sub> (21.4 ppm as NO<sub>3</sub>), hence the useful option to blend treated water with raw water on a 50% basis could be applied. It

would be of no advantage to move to counter-current regeneration in this case. Reference to Fig. 5 will show that the basic capacity curve is very similar. However the throughput will be lower, because the reduced leakage increases the ion exchange load for a given throughput. When on the other hand nitrate concentrations or ratios are higher, it may be advantageous to operate counter-current rather than increase the regeneration level while operating co-current. In this way a suitable blend may be obtained with lower regenerant costs (and costs of disposal).

## NOTES

**U.S.A.**

The Purolite Company  
150 Monument Road  
Bala Cynwyd, PA 19004  
Phone: (1) 610-668-9090  
Toll Free: 800-343-1500  
Telefax: (1) 610-668-8139  
Email: [sales@puroliteUSA.com](mailto:sales@puroliteUSA.com)

**TEXAS**

The Purolite Company  
1700 West Loop South  
Suite 740  
Houston, TX 77027  
Toll Free: 800-562-6488  
Telefax: (1) 713-627-7890

**CANADA**

The Purolite Company  
625 Wabanaki Drive  
Unit #2  
Kitchener, Ontario N2C 2G3  
Toll Free: 800-461-1500  
or (1) 519-896-6674  
Telefax: (1) 519-896-6679

**UNITED KINGDOM**

Purolite International Limited  
Kershaw House  
Great West Road  
Junction with Lampton Road  
Hounslow, TW5 OBU  
Sales Phone: (44) 181-570-4454  
Telefax: (44) 181-572-7726  
  
European Marketing  
Phone: (44) 181-577-1222  
Telefax: (44) 181-577-1136

**GERMANY**

Purolite Deutschland GmbH  
Harkort Strasse 25  
40880 Ratingen  
Phone: (49) 2102-46033  
Telefax: (49) 2102-443663

**FRANCE**

Purolite International SARL  
34 Avenue Matignon  
75008 Paris  
Phone: (33) 1-4256-4563  
Telex: 648856  
Telefax: (33) 1-4563-3826

**SPAIN**

Purolite Iberica S.A.  
Parc Tecnologic del Valles  
Centre Empreses Noves Technologies  
08290 Cerdanyola del Valles (Barcelona)  
Phone: (34) 3-582-0266  
Telefax: (34) 3-582-0268

**EGYPT**

Purolite International Middle East  
Cairo Liaison Office  
12 Obour Gardens  
Fifth Floor, App. No. 55  
Salah Salem Street  
Nasr City, Cairo  
Phone: (20) 2-4021477  
Telefax: (20) 2-4021478

**ITALY**

Purolite International S.r.l.  
Viale Coni Zugna 29  
20144 Milan  
Phone: (39) 02-481-8145  
Telefax: (39) 02-4801-2359

**ROMANIA**

Purolite Romania  
International Business Center Modern  
B-dul Carol I No. 34-36  
5th Floor  
Bucharest, Sector 2  
Phone: (40) 1-250-5053/5028  
Telefax: (40) 1-250-5999

**POLAND**

Head Office  
Radus Spolka z o.o.  
ul Przebendowskich 33  
81-543 Gdynia  
Phone/Fax: (48) 58-6248118

**GLIWICE**

Radus Spolka z o.o.  
ul Górnych Wałów 25  
44-100 Gliwice  
Phone: (48) 32-315-931  
Telefax: (48) 32-315-931

**SLASK**

Radus Spolka z o.o.  
ul 3 Maja 3/33  
32-600 Oswiecim  
Phone: (48) 33-425-603  
Telefax: (48) 33-425-603

**CZECH & SLOVAK REPUBLICS**

Purolite International  
Nad Mazankou 17  
182 00 Prague 8  
Phone: (420) 2-688-1086  
Telefax: (420) 2-688-1086

**RUSSIA**

Head Office  
Purolite International  
10th Floor  
36 Lyusinovskaya Street  
Moscow  
Phone: (7) 095-564-8120  
Telefax: (7) 095-564-8121

**ST. PETERSBURG**

Purolite International Limited  
12 Building A Tambovskaya St.  
St. Petersburg  
192007 Russian Federation  
Phone: (7) 812-327-8530  
Telefax: (7) 812-327-9079

**KAZAKHSTAN**

Purolite RH Limited  
Office 205  
240 Dostyk AV.  
Almaty 480051  
Phone: (7) 3272-641-234  
Telefax: (7) 3272-641-234

**SINGAPORE**

Purolite International (Singapore)  
PTE Limited  
32-04 The Concourse  
300 Beach Road, 199555  
Phone: (65) 297-0889  
297-1453  
Telefax: (65) 297-1986

**CHINA**

Head office  
Purolite (China) Company, Ltd.  
Chengguan Town  
Deqing County  
Zhejiang Province 313200  
Phone: (86) 572-842-2908  
Telefax: (86) 572-842-3954

**TAIWAN**

Purolite International  
16F-2, No. 191  
Fu-hsing N. Road, Taipei  
Phone: (886) 2-546-7078  
Telefax: (886) 2-546-7069

**MEXICO**

Purolite International, S.A. De C.V.  
World Trade Center  
Montecito 38, Piso 33, Oficina-19  
Mexico D.F. 03810  
Phone: (52) 5-488-0904  
Telefax: (52) 5-488-0906

**UKRAINE**

Purolite International Limited  
2 Korolenko Street.  
Dnepropetrovsk 320070  
Phone: (38) 0562-320-065  
0562-320-066  
Telefax: (38) 0562-320-067

**KOREA**

Purolite International (Korea) LLC  
Dae Yeon Bldg., Suite 403  
943-30 Daechi-dong  
Kangnam-gu, Seoul  
Phone: (82) 2-3453-7062/7063  
Telefax: (82) 2-3453-7064